

NOTE:

ON EXISTING DUCTWORK IT IS SUGGESTED TO TEST THE ADHESION OF THE ROLLED SEALANT PRIOR TO PERFORMING THE SEALING WORK. FOR OLDER DUCTWORK THE INSTALLER CAN USE AN ADHESIVE TO PRIME THE SURFACE FOR ROLLED SEALANT APPLICATION.


FO-2A

SLIP & DRIVE

CARLISLE
HVAC PRODUCTS

© 2014 CARLISLE CORPORATION

4" STRIP OF
FOIL-GRIP 1402/
FOIL-GRIP 1404

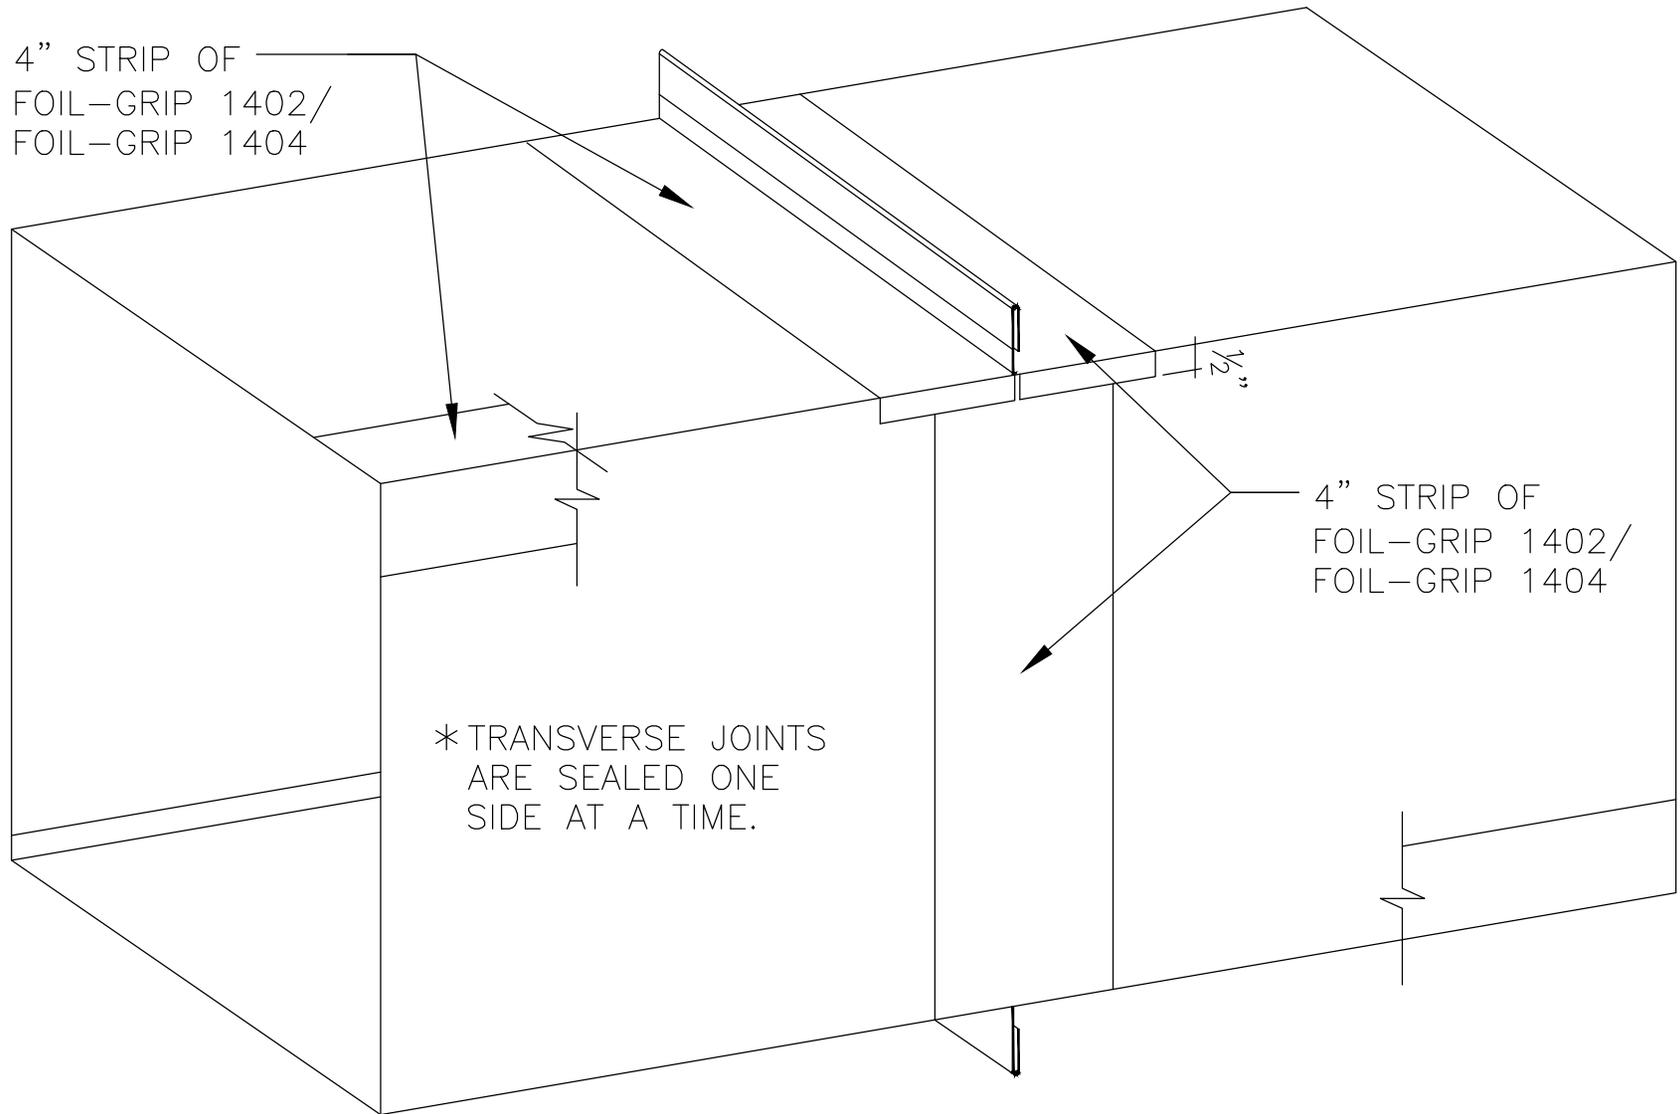

4" STRIP OF
FOIL-GRIP 1402/
FOIL-GRIP 1404

* TRANSVERSE JOINTS
ARE SEALED ONE
SIDE AT A TIME.

NOTES:

1. CUT AND CENTER 4" WIDE COVER STRIP OF FG-1402/ FG-1404. SQUEEGEE FOIL-GRIP 1402/ FOIL-GRIP 1404 TO CONFORM TO SURFACE AND TO ELIMINATE WRINKLES.
2. THE STANDING SLIP WILL REQUIRE TWO SEPERATE PIECES OF FOIL-GRIP 1402/ FOIL-GRIP 1404.
3. SPLICE FG-1402/ FG-1404 INTO EACH SIDE A MINIMUM OF $\frac{1}{2}$ ".

FO-2C

SLIP & DRIVE

CARLISLE
HVAC PRODUCTS

© 2014 CARLISLE CORPORATION